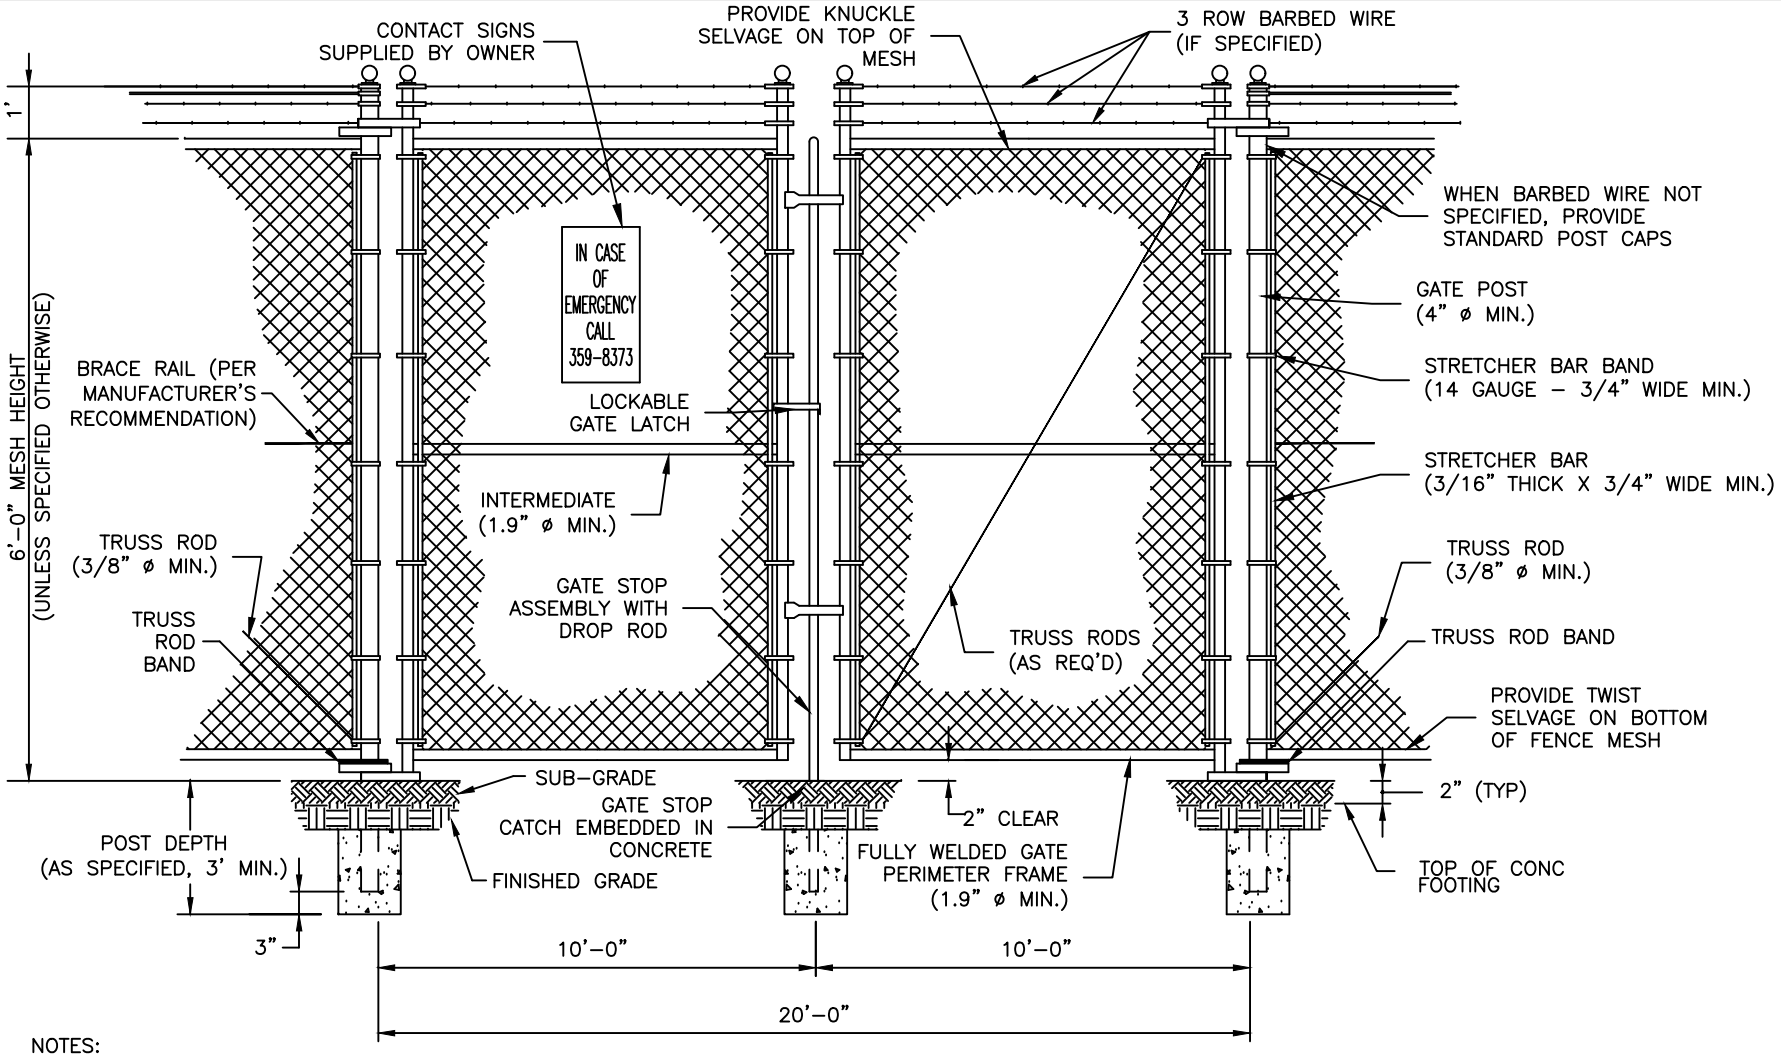

NOTES:

1. REFER TO JMWSC STANDARD SPECIFICATION – CHAIN LINK FENCES AND GATES.
2. REFER TO JMWSC STANDARD DETAILS – TYPICAL FENCE SPAN AND TYPICAL FENCE CORNER.
3. PROVIDE GATE KEEPERS AT LOCATIONS AS IDENTIFIED ON THE PLANS. IF NOT SPECIFIED, KEEPERS SHALL BE LOCATED AT THE BEST POSSIBLE LOCATION WITHOUT IMPACTING ANY INFRASTRUCTURE OR ACCESS LIMITATIONS.
3. FOR PUMP STATIONS: PROVIDE 3–1/2" X 5" MESH, 8 GAUGE FINISH, 9 GAUGE CORE FUSED AND BONDED BLACK (COLOR) VINYL COATED WIRE WITH PRE–INSERTED HIGH DENSITY POLYETHYLENE SELF–LOCKING SLATS OR APPROVED EQUAL.
   FOR WATER STORAGE TANKS: PROVIDE 2" MESH, 8 GAUGE FINISH, 9 GUAGE CORE FUSED AND BONDED BLACK COLOR) VINYL COATED WIRE.
4. ALL FENCING/GATE MATERIALS AND ACCESSORIES SHALL BE BLACK IN COLOR.

DATE: 10/1/2024	REVISIONS	STANDARD DETAIL	JOINT MUNICIPAL WATER AND SEWER COMMISSION
SCALE: NTS		TYPICAL DOUBLE SWING DRIVE GATE	FILE NO. G002