


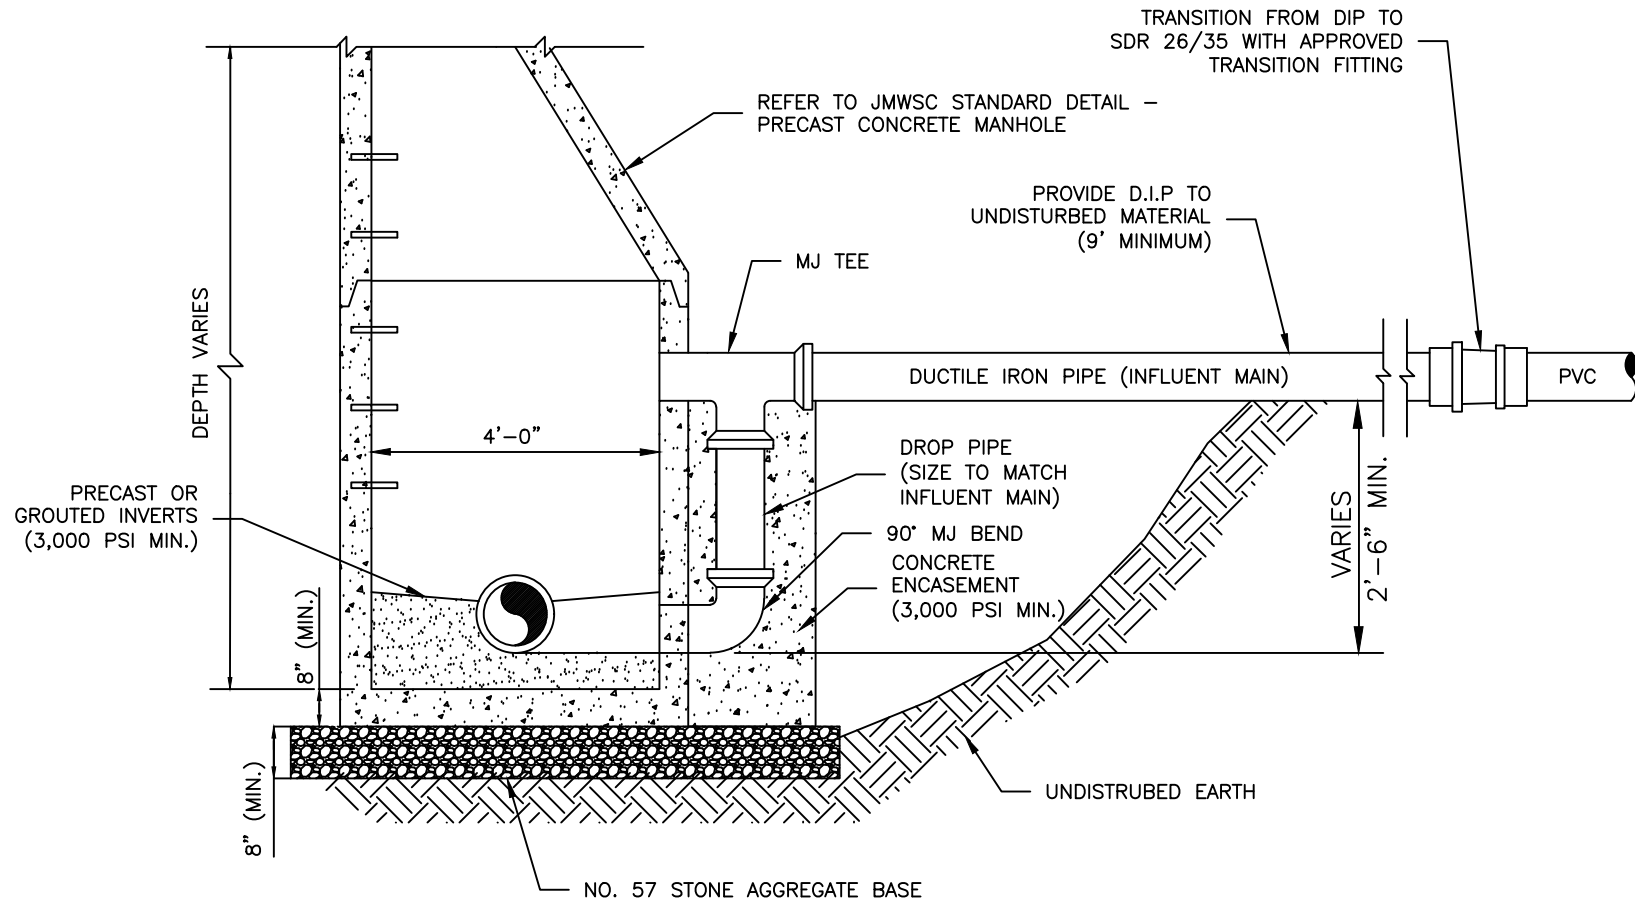

NOTES:

1. PIPE/FITTING SIZES VARY.
2. ALL DIP PIPE AND FITTINGS SHALL BE PROTECTO 401 LINED.
3. REFER TO JMWSC STANDARD SPECIFICATION – MANHOLES.
4. REFER TO JMWSC STANDARD SPECIFICATION – GRAVITY SEWER

DATE: 10/1/2024	REVISIONS		STANDARD DETAIL		JOINT MUNICIPAL WATER AND SEWER COMMISSION
SCALE: NTS					DROP MANHOLE