


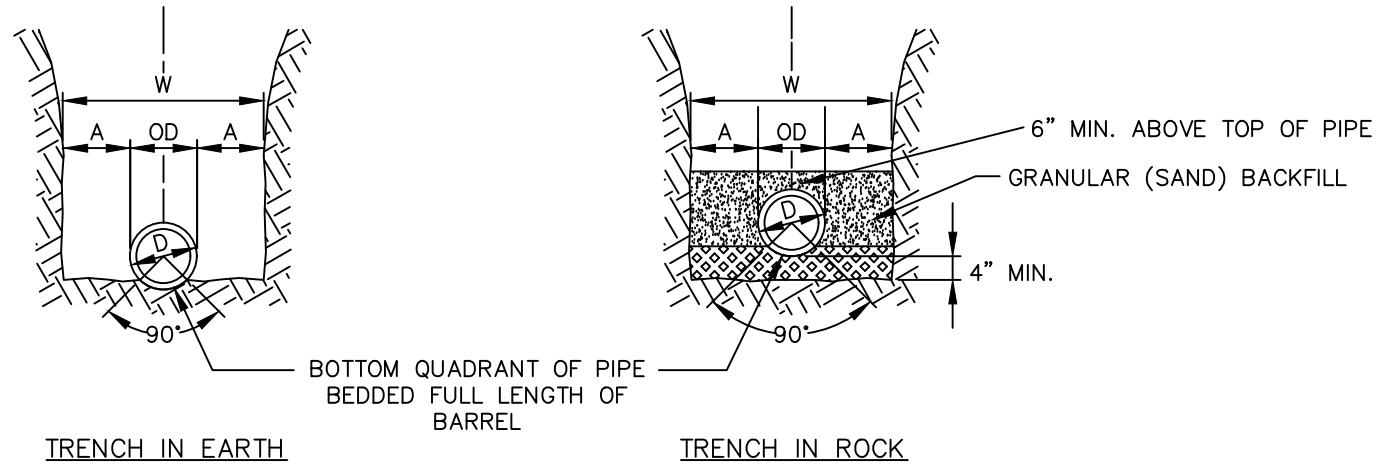

PIPE DIA. "D"	MAXIMUM "A"
6" TO 15"	8"
18" TO 21"	10"
24" TO 30"	12"
33" TO 42"	15"
48" & LARGER	18"

NOTES:

1. BACKFILL TRENCHES WITH APPROVED BACKFILL TAMPED IN 6" LAYERS TO 1'-0" ABOVE PIPE.
2. MAXIMUM TRENCH WIDTH "W" TAKEN AT TOP OF PIPE.
3. REFER TO JMWSC STANDARD SPECIFICATION – EXCAVATION, TRENCHING, AND BACKFILLING FOR UTILITIES

DATE: 10/1/2024	REVISIONS		STANDARD DETAIL		JOINT MUNICIPAL WATER AND SEWER COMMISSION
SCALE: NTS			STANDARD PIPE TRENCH BEDDING		FILE NO. WLO11